



To Our Customers,

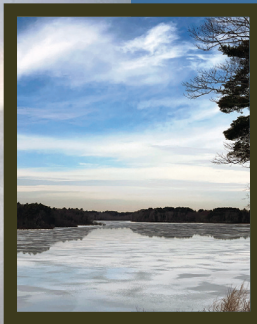

2025 was both a challenging and successful year for the Salem and Beverly Water Supply Board (the Board) and its staff. The Board made great progress with our new, multiphase 20-year Capital Sustainability and Best Management Practices Programs during the course of the year. The Board is approximately halfway through the construction of its current \$8.7 million dollar Capital Improvement Contract 2022-1: Facilities Upgrades. This project is scheduled to be completed in the spring of 2027 and is being funded with previously allocated funds planned for this purpose. Additionally, the Board is approximately midway through the development of its next 20-Year Asset Management Master Plan. This plan will provide the Board and the communities it serves with a plan of sustainable actions, financial and legislative needs, and a timeline of milestones to sustain its operation into the future. This Master Plan is being funded by a grant from the Massachusetts Department of Environmental Protection (MassDEP) and is planned to be completed in 2026. These efforts are being undertaken to ensure the Board succeeds in its mission to deliver our customers a high-quality, reliable, and resilient water supply now, and for generations to follow. This sustainability program will require careful and strategic planning along with significant public support, legislative actions, and funding.

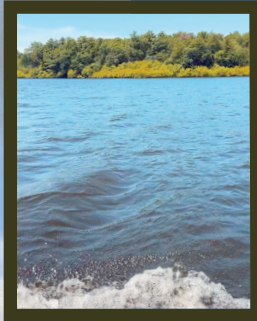

Summer (top)
and Winter
(bottom)
on Wenham
Reservoir

This report describes the Board's raw water sources, drinking water treatment process, and water quality performance data for the year 2025. As part of our ongoing commitment to increase public communication, awareness, and transparency, this report includes information beyond the minimum requirements related to your drinking water for the protection and sustainability of our most precious and valuable resource.

Once again, it has been a great pleasure to serve you all in 2025, and the Board looks forward to a productive and successful 2026.

Sincerely,


Alan F. Taubert, Jr., PE, CEM, Executive Director, (Retired 2026)
Salem and Beverly Water Supply Board

Salem and Beverly Water Supply Board | PWS ID 3030001
Salem Water Department: PWS ID 3258000 | Beverly Water Department: PWS ID 3030000

For Water Quality
Questions, Contact
Executive Director:

Bradley Perron
978-922-2600

For Water Distribution
Questions, Contact
Your City Water
Department:

Salem
 **978-745-9595**
ext. 5673

Beverly
 **978-921-6000**
ext. 2358


Rainbow over Wenham Reservoir

2025

Drinking Water QUALITY Report

DISTRIBUTED JUNE 2026

Continuing the 20-Year Capital Sustainability and Best Management Practices Program!

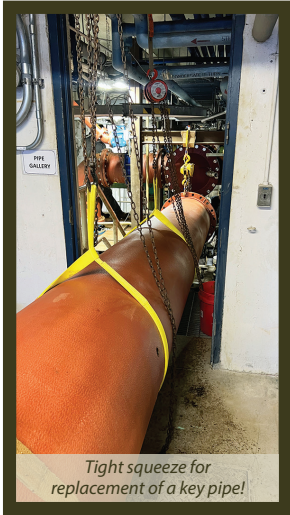

The Board continues to progress through its 20-Year Capital Sustainability and Best Management Practices Program under Contract 2022-1: Facilities Upgrades and to develop the Asset Management Master Plan.

Contract 2022-1: Facilities Upgrades

During 2024, the Board awarded Contract 2022-1: Facilities Upgrades a total of \$8.68 million to make critical improvements to the water filtration plant and reservoir facilities. Construction kicked off in 2025, steadily progresses every day, and is scheduled to be completed in 2027.


Asset Management Master Plan

The Board is currently developing a 20-Year Asset Management Master Plan supported by grant funding from the MassDEP. This will lay out a strategic plan for supporting the capital needs of the Board's facilities over the next 20 years. Execution of this Master Plan will require significant public support, legislative action, and funding from the communities for the Board to succeed in its mission to deliver a high-quality, reliable, and resilient water supply now and for generations to follow.

A summary of Contract 2022-1: Facilities Upgrades includes:

- ◆ Rehabilitation of the Longham Reservoir Bar Screen Intake and Modification to the Putnamville Reservoir Gatehouse
- ◆ Sedimentation Basin Chain Replacement and Repairs
- ◆ Filter-Media Replacement and Filtration Process Improvements
- ◆ Replacement of Large-Diameter Piping and Valves
- ◆ Improvement of Chemical Feed Systems

The Board's Source Water & Process Flow Diagram

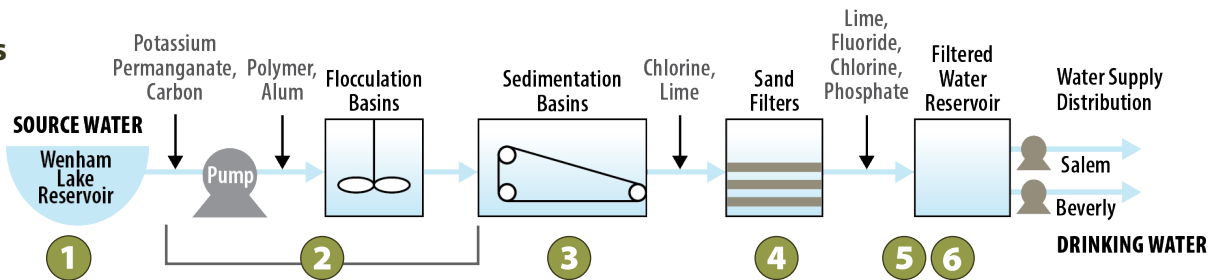

Water Purification Process

The source waters of the Board's reservoir system undergo extensive treatment at the water treatment plant on the shores of Wenham Lake Reservoir in Beverly before drinking water is delivered to your home or business. The water is treated to exceed all federal and state drinking water standards established by the EPA and MassDEP. The plant removes naturally occurring impurities from the source water as required by federal regulations and good public health practices.

To ensure the highest quality water, the Board continuously monitors the effectiveness of the treatment process and makes necessary adjustments to the treatment to maintain water quality.

1 SOURCE WATER: Raw water for the water treatment plant is drawn from Wenham Lake Reservoir.

2 and 3 PRETREATMENT: The first step in the treatment process combines preoxidation with potassium permanganate, adsorption with carbon and coagulation with alum and polymer, followed by gravity settling to remove manganese; natural color, taste, and odor; and sediment and particles.

4 FILTRATION: The water passes through sand and anthracite media to remove organic compounds. Filtration also acts as a "polishing step" to remove additional particles, color, and bacteria.

5 DISINFECTION: Sodium hypochlorite is used to provide disinfection of the filtered water to kill bacteria and viruses and to maintain a protective residual throughout the distribution system.

6 POSTTREATMENT: Fluoride is added to prevent tooth decay/cavities. To maintain corrosion control in the distribution pipes, the Board adjusts the pH and uses a phosphate additive designed to optimize corrosion control throughout the distribution system and minimize dissolved lead in the pipes and household plumbing.



Where Does Your Water Come From?


The Board provides potable water to the Cities of Salem and Beverly for drinking, sanitation, and fire protection. The Board maintains the source waters, treats the water at the Arlington Avenue water treatment plant located in North Beverly, and delivers water to the individual Salem and Beverly pumping stations. The pumping stations deliver drinking water to your home in pipes owned and maintained by each city's water department.

Salem and Beverly use over 3 billion gallons of drinking water each year. This water is drawn from the Ipswich River and three reservoirs: Wenham Lake, Putnamville, and Longham.

Beverly's water mains have interconnections with Salem, Wenham, Danvers, and Manchester-by-the-Sea. Salem's water mains

have interconnections with Beverly, Marblehead, and Peabody.

The Board recognizes the importance of storing high winter and spring flows of the Ipswich River for use in summer when river flows are naturally low. Between December 1 and May 31, when there is excess water in the river, water is pumped to the Putnamville Reservoir and/or Wenham Lake Reservoir for storage and use during summer and fall each year. Water is not pumped from the Ipswich River from June 1 through November 30. Similarly, Longham Reservoir augments Wenham Lake Reservoir.

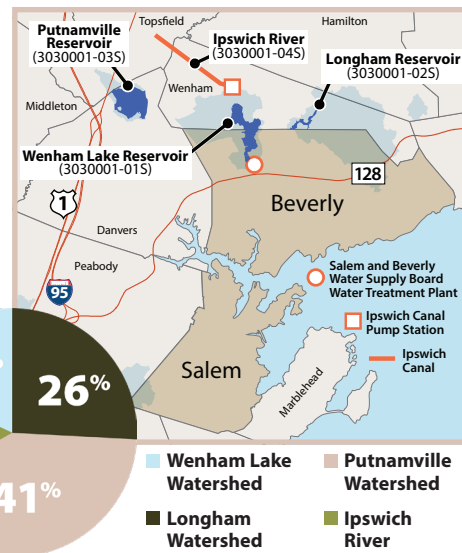

Important Information from EPA & MassDEP about Sources of Drinking Water and Drinking Water Contaminants

Sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

To ensure tap water is safe to drink, MassDEP and U.S. Environmental Protection Agency (EPA) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The Food and Drug Administration (FDA) and the Massachusetts Department of Public Health regulations establish limits for contaminants in bottled water that must provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contamination. The presence of contaminants does not necessarily indicate that water poses a health risk.

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be


particularly at risk from infections. These people should seek advice from their health care providers. EPA/Centers for Disease Control and Prevention (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the **Safe Drinking Water Hotline: 800-426-4791**.

Lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The Board is responsible for providing high quality drinking water and removing lead pipes, but cannot control the variety of materials used in plumbing components in your home. You share the responsibility for protecting yourself and your family from the lead in your home plumbing. You can take responsibility by identifying and removing lead materials within your home plumbing and taking steps to reduce your family's risk. Before drinking tap water, flush your pipes for several minutes by running your tap, taking a shower, doing laundry or a load of dishes. You can also use a filter certified by an American National Standards Institute accredited certifier to reduce lead in drinking water. If you are concerned about lead in your water and wish to have your water tested, contact the Board. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available at Epa.gov/Safewater/Lead.

Contaminants that may be present in source water include:

- ◆ **Microbial contaminants**, such as viruses and bacteria, may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- ◆ **Inorganic contaminants**, such as salts and metals, can be naturally occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, and farming.
- ◆ **Pesticides and herbicides** may come from a variety of sources, such as agriculture, urban stormwater runoff, and residential uses.
- ◆ **Organic chemical contaminants** include synthetic and volatile organic chemicals that are byproducts of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, and septic systems.
- ◆ **Radioactive contaminants** can be naturally occurring or the result of oil and gas production and mining activities.

Massachusetts Source Water Assessment and Protection Program

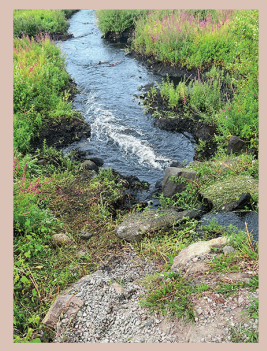

The Source Water Assessment and Protection (SWAP) Program assesses the susceptibility of public water supplies to contamination from land uses and activities within the recharge area of Salem's and Beverly's water supply.

The water supply for these cities consists of surface water from:

- ◆ Wenham Lake (Source ID #3030001-01S)
- ◆ Longham Reservoir (Source ID #3030001-02S)
- ◆ Putnamville Reservoir (Source ID #3030001-03S)
- ◆ Ipswich River (Source ID #3030001-04S)

A bubbling stream winds through the summer landscape

MassDEP assigned a susceptibility rating of "high" to this system using the information collected during their assessment. A high ranking is given to any water supply that has at least one high threat within the water supply protection area. Because there are 17 potential high-threat land uses within the protection area, the Salem and Beverly water supply must be assigned a high susceptibility ranking. The potential contaminant sources within the protection area are manure storage or spreading, pesticide storage or use, airports, body shops, gas stations, service stations/auto repair shops, bus and truck terminals, dry cleaners, photo processors, repair shops (e.g., engine, appliance), hazardous materials storage, machine/metalworking shops, hazardous waste facilities, large quantity hazardous waste generators, landfills and dumps, military facilities (past and present), and underground storage tanks. This ranking does not imply that the cities have poor water quality or will have poor water quality in the future. It only

draws attention to various activities within the watershed that may be potential sources of contamination.

The SWAP then assesses what the water supplier is doing to prevent contamination and recommends other measures that can be taken to further protect the sources. The Board has already implemented some source protection measures, including reviewing the development of plans in the City of Beverly and the Towns of Wenham and Topsfield, conducting stream monitoring throughout the watersheds, and managing geese on Wenham Lake.

For more information, the complete SWAP report is available at the Board and online on page 72, 120, and 986 of the following PDF:

mass.gov/doc/northeast-region-source-water-assessment-protection-swap-program-reports/download

You can also call the Board at (978) 922-2600.

Protect Your Drinking Water at Home!

A "cross connection" is a connection between a drinking water pipe and a polluted source. The pollution can come from your own home. For instance, to spray fertilizer on your lawn, you hook your hose up to the sprayer that contains the fertilizer. If the water pressure drops (for example, because of fire hydrant use in the city) when the hose is connected to the fertilizer, the fertilizer may be sucked back into the drinking water pipes through the hose. Over half of cross-connection incidents involve unprotected garden hose, which could be prevented using a hose bib device.

For more information on cross connections and the status of our program, contact your city's water department:

Salem:
(978) 619-5673
ext. 5673

Beverly:
(978) 921-6000
ext. 2358

Nonpoint Source Pollution

EPA Phase II Stormwater regulations require all communities with populations under 100,000 to implement control measures aimed at reducing water pollution caused by stormwater runoff. Stormwater runoff is a major component of nonpoint source (NPS) pollution. According to EPA, NPS pollution constitutes the nation's largest source of water quality problems. NPS pollution occurs when runoff (rainwater or snowmelt) moves over the land, picking up sediments and contaminants and then depositing them into lakes, rivers, and coastal waters. Overland flow picks up pollutants from driveways, crops, industrial sites, or malfunctioning septic systems before discharging into the river or storm drain.

NPS pollution can lead to beach closures, fish kills, habitat destruction, and unsafe drinking water. Unlike point sources (e.g., discharge pipes from facilities), NPS are diffuse, which makes them difficult to trace and control. The Board provides robust watershed protection (including limiting access to the public) to control NPS pollution and the source of drinking water for their customers.


Household contributors to NPS pollution include improperly disposed pet waste, lawn fertilizer, paints, and motor oil. Automobiles, factories, and wood stoves emit airborne contaminants that return to the earth in the form of rain or snow. The amount of these contaminants that reach water sources is increased by impermeable surfaces such as roofs and pavements, which keep the soils from naturally filtering stormwater.

The Cities of Salem and Beverly have implemented Stormwater Management Plans (SWMP) designed to reduce stormwater runoff pollution and protect your



source and surface waters. Involving the public through education and participation are required control measures for the SWMP.

Misty morning at Wenham Reservoir intake building



Hose Bib Backflow Preventer

REGULATED COMPOUNDS					
Compound	Highest Level Found	Range of Detections (low – high)	Highest Level Allowed (MCL or MRDL)	Ideal Goal (MCLG or MRDLG)	Possible Source
Barium	0.02 ppm	Single Sample	2 ppm	2 ppm	Erosion of natural deposits
Chlorine	0.69 ppm ^[1]	0.01 – 2.20 ppm ^[2]	4 ppm	4 ppm	Water disinfectant
Copper ^[3]	Both: 0.16 ppm Salem: 0.16 ppm Beverly: 0.15 ppm	0.019 – 0.27 ppm ^[4] 0.019 – 0.22 ppm ^[4] 0.021 – 0.27 ppm ^[4]	AL = 1.3 ppm	0 ppm	Corrosion of household plumbing systems
Di(2-ethylhexyl)phthalate	0.66 ppb	Single Sample	6 ppb	0 ppb	Discharge from rubber and chemical factories
Fluoride	0.88 ppm	0.03 – 0.88 ppm	4 ppm ^[4]	4 ppm	Added to water to promote strong teeth
Lead ^[3, 5]	Both: 1.7 ppb Salem: 1.5 ppb Beverly: 1.8 ppb	ND – 3.4 ppb ^[4] ND – 3.4 ppb ^[4] ND – 2.7 ppb ^[4]	AL = 15 ppb	0 ppb	Corrosion of household plumbing systems
PFAS ^[6]	9 ppt	3 – 9 ppt	20 ppt	–	‡ Discharges and emissions from industrial and manufacturing sources associated with the production or use of these PFAS, including production of moisture- and oil-resistant coatings on fabrics and other materials. Additional sources include the use and disposal of products containing these PFAS, such as firefighting foams.
Total Haloacetic Acids ^[7]	53 ppb ^[1]	15 – 65 ppb ^[2]	60 ppb ^[8]	0 ppb	Byproduct of water disinfection
Total Trihalomethanes ^[7, V]	81 ppb ^[1]	25 – 132 ppb ^[2]	80 ppb ^[8]	0 ppb	Byproduct of water disinfection
Turbidity ^[8]	0.34 NTU	0.05 – 0.34 NTU	TT = 0.3 NTU ^[9]	N/A	Suspended matter from soil runoff

SECONDARY/GUIDELINE CONTAMINANTS

Compound	Highest Level Found	Range of Detections (low – high)	Highest Guidance Level (SMCL or ORSG)	Ideal Goal (MCLG or MRDLG)	Possible Source
Chloroform	23 ppb	Single Sample	70 ppb	–	Byproduct of water disinfection
Manganese ^[9]	46 ppb	Single Sample	50 ppb	–	Naturally occurring mineral
Odor	12 T.O.N.	Single Sample	3 T.O.N.	–	Naturally occurring organic materials that form ions when in water
Sodium ^[10]	53 ppm	Single Sample	20 ppm	–	Discharge from the use and improper storage of sodium-containing deicing compounds or in water-softening agents

UNREGULATED CONTAMINANTS	Compound	Average	Range of Detections (low – high)	Possible Source
	PFHxA	2.7 ppt	2.4 – 3.1 ppt	Refer to ‡ above
Nickel	1.3 ppb ^[11]	Single Sample	Discharge from domestic wastewater, landfills, and mining and smelting operations	

Notes

- ^[1] Highest level detected is based on a running monthly or quarterly average of samples.
- ^[2] Highest value in range is based on individual samples, rather than averages.
- ^[3] The Action Level (AL) and the highest level found are based on the 90th percentile of the samples. The range represents all individual samples. Results shown are from 2023 sampling.
- ^[4] Fluoride also has an SMCL of 2.0 ppm.
- ^[5] Exposure to lead in drinking water can cause serious health effects in all age groups. Infants and children can have decreases in IQ and attention span. Lead exposure can lead to new learning and behavior problems or exacerbate existing learning and behavior problems. The children of women who are exposed to lead before or during pregnancy can have increased risk of these adverse health effects. Adults can have increased risks of heart disease, high blood pressure, kidney, or nervous system problems.
- ^[6] PFASs comprise six compounds: perfluorooctane sulfonic acid (PFOS), perfluoro-octanoic acid (PFOA), perfluorohexane sulfonic acid (PFHxS), perfluorononanoic acid (PFNA), perfluorheptanoic acid (PFHpA), and perfluorodecanoic acid (PFDA).
- ^[7] Highest level allowed (MCL) for this substance is based on the average of four samples taken quarterly.
- ^[8] All samples met the TT requirement.
- ^[9] EPA has established a lifetime health advisory (HA) of 300 ppb to protect against potential neurological effects, and 1-day and 10-day HA of 1.0 ppm for acute exposure. Manganese is naturally present in the environment.
- ^[10] The MassDEP ORSG has set a guideline concentration of 20 ppm for sodium. Sodium-sensitive individuals, such as those experiencing hypertension, kidney failure, or congestive heart disease, should be aware of the sodium levels if exposures are being carefully controlled.
- ^[11] The ORSG for nickel is 100 ppb. The result represents a single value instead of an average. Only one sample was required per the MassDEP-approved sample schedule.
- ^[V] Violation of TTHM received in Quarter 3 (August 2025). More information is provided on the back page of this report.

Terms and Abbreviations

AL: Action Level – The concentration of a contaminant that, if exceeded, triggers treatment or other requirements that a water system must follow.

MCL: Maximum Contaminant Level – The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG: Maximum Contaminant Level Goal – The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDL: Maximum Residual Disinfectant Level – The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary to control microbial contaminants.

MRDLG: Maximum Residual Disinfectant Level Goal – The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the level of disinfectants required to control microbial contaminants.

N/A: Not Available – An ideal goal has not been established by EPA or MassDEP for this compound.

ND: Not Detected

NTU: Nephelometric Turbidity Unit – A measure of the turbidity (or clarity) of water. It is monitored because it is a good indicator of the effectiveness of our filtration system.

ORSG: (Massachusetts) Office of Research and Standards Guideline – Guidance values developed by MassDEP ORS in absence of any other federal standards or guidance.

ppb: Parts per Billion or Micrograms per Liter (µg/L) – One part per billion is the equivalent of \$1 in \$1,000,000,000.

ppm: Parts per Million or Milligrams per Liter (mg/L) – One part per million is the equivalent of \$1 in \$1,000,000.

ppt: Parts per Trillion or Nanograms per Liter (ng/L) – One part per trillion is the equivalent of \$1 in \$1,000,000,000,000.

SMCL: Secondary Maximum Contaminant Level – Concentration limit for a contaminant that may have aesthetic effects such as taste, odor, or staining.

T.O.N.: – Total Odor Number

TT: Treatment Technique – A required process intended to reduce the level of a contaminant in drinking water.

Unregulated Contaminants: Unregulated contaminants are those for which there are no established drinking water standards. The purpose of unregulated contaminant monitoring is to assist regulatory agencies in determining their occurrence in drinking water and whether future regulation is warranted.

90th Percentile: Nine out of every 10 homes were at or below this level.



Salem and Beverly Water Supply Board
50 Arlington Avenue
Beverly, MA 01915

Presorted
Standard
US Postage
Paid
North Reading
Permit No. 215

ECRWSS POSTAL PATRON

Manganese and Discolored Water

Manganese is a naturally occurring mineral in the environment, and at certain times of the year can be present at low levels in our drinking water. While an essential nutrient, at these low levels it can accumulate over time in the pipes that bring water to our customers. Flow changes from construction, use of hydrants, and water main breaks can stir up that material and contribute to these temporary events of discolored water.

If you are experiencing discolored water, run your cold water from the lowest point in your home, or your outdoor spigot, until it runs clear. If the water remains discolored, pause an hour and resume flushing after the system has settled.

Wait until your water is clearer to wash light-colored clothing. Darker clothing should not be affected. If you have had any staining issues with your light clothing, you can try using "Red-B-Gone" to potentially remove any staining.

To deliver a high-quality, reliable, and resilient water supply to our customers. ~The Board's Mission

Providing reliable drinking water for 112 Years to +90K Residents

Sunset over the treatment facility

Water Service Line Inventory



The Cities of Salem and Beverly, in conjunction with the Board, have conducted an inventory of their customer service pipe materials with the goal of identifying lead components of the drinking water system. While there have been no identified instances of lead exceedances, we are mandated to identify and address any potential source of lead that may exist.

See the contact information below to find out more on service line inventories in your community:

Salem:  **978-619-5673**



www.SalemMA.gov/Water-sewer/Pages/Lead-services

Beverly: Call Beverly Engineering at  **978-605-2355**

Total Trihalomethanes (TTHM) and Your Drinking Water

TTHM are a group of compounds formed when the chlorine that is added for disinfection combines with organic matter in the water. The longer the chlorine is in contact with the organics, the higher the TTHM. This length of time is often called "water age." The levels are regulated by a running annual average at specific MassDEP-approved sampling locations in the distribution system. During Quarter 3 (August 2025), the average at the Homes Street Pump Station sampling location exceeded the maximum contaminant level (MCL). The Board conducted an investigation into the event and determined additional loading on the WTP contributed to increased organic matter entering the distribution system. Additionally, the Board worked with the water departments from the Cities of Salem and Beverly to augment their annual flushing programs to reduce the water age of the system. The Board is also updating certain key process system as part of the Facilities Upgrades. These combined actions will help reduce TTHM levels.